



“ ”

2025    1    1    12    31

2025  
GB/T 36000-2015  
GB/T 36001-2015  
GB/T 36002-2015

CASS-CSR3.0  
(GSRI-CHINA 2.0)

<http://www.hogn.com.cn>

1983

20,070 ( )

17 2022

$\pm 800\text{kV}$  /750kV 220kV

800 120 10 35 ,  
1 5 58 500 100

KEMA UL BV  
30

500

“ ” “ ”  
“ ” “ ” “ ”  
”

“ ”

20%

“ ”

“ ”




|  |  |  |  |
|--|--|--|--|
|  |  |  |  |
|--|--|--|--|

/

3.2

3.2.1

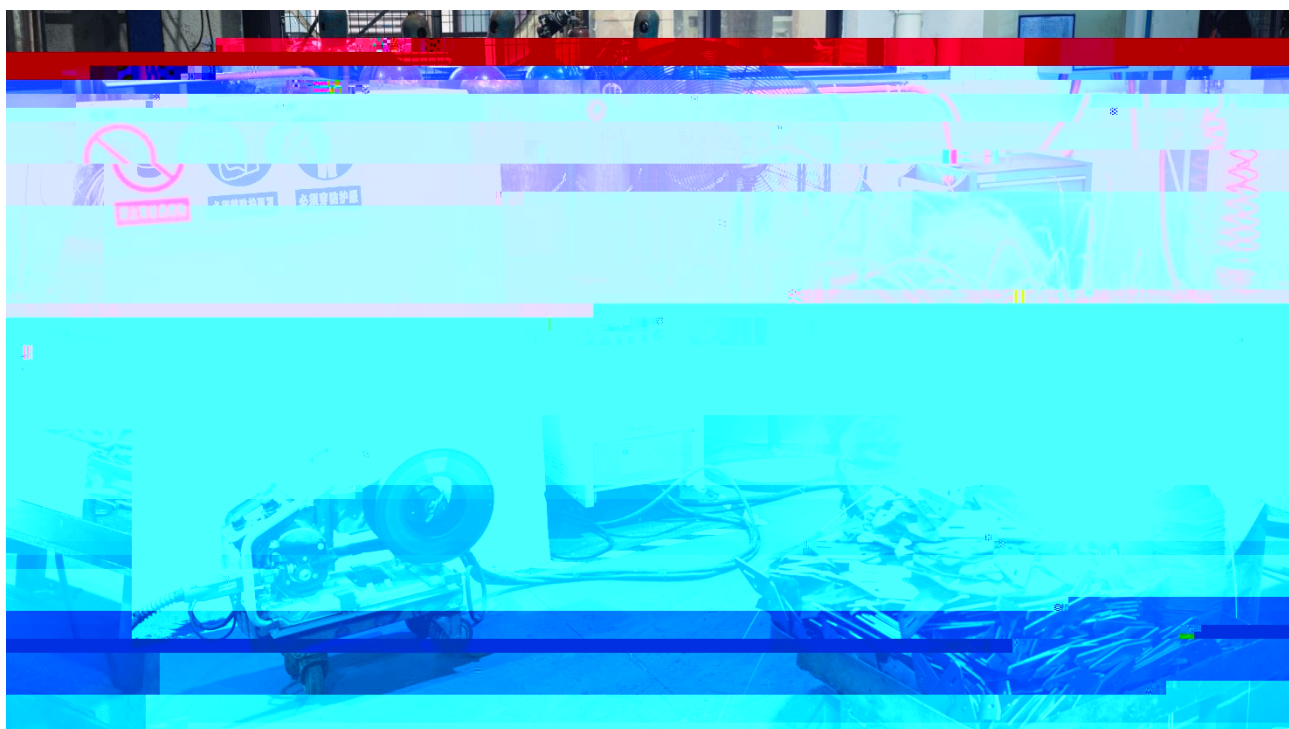

“ ”

50 /

24000

3.3.3

QC

3.3.4

2024 303.5

3.3.5





“ ” “ ”

3.4.2



### 3.6



ISO50001 2018

3.7

3.7.1

“ ” “ ” “ ” “ ”

3.7.2

/

3.7.3

28

98

55



3.8

3.8.1

/

3.8.2

“ ; ”

“ ”

3.8.3

24H /

3.8.4

3.8.5

3.9

